

APPENDIX - VIII

PROFORMA REGARDING SAFE DRINKING WATER AND SANITARY CONDITION
CERTIFICATE.

No. DPSK/12/18/22-23
C S I / 23946

Date : 12/12/22

It is certified that an inspection team headed by Vipul Jain (Name of Officers with designation) from C S I Systems (Name of Department/Office) inspected the Delhi Public School, Kota In front of Gopurmath forest Chaki Bawat Bhatia Road (Name & Address of the School) on 07/12/2022 and found that the Delhi Public School Kota (RatkanKara) (Name of school) has safe drinking water facilities for the students and members of staff of the institution and is maintaining the hygienic sanitation condition in the school building & the campus as per the norms prescribed by the Central/State/U.T Govt.

The above valid for a period of 06 months.

Signature with Seal :

Name

Designation



Vipul Jain

Marketing Head

To

Delhi Public School

In front of Gopurmath forest

Chauki, Bawat Bhatia Road - RatkanKara

(Name & Address of the Institution)

Handwritten signature in green ink





C & I SYSTEMS

H-13(d), Electronic Complex,
Road No. 1, I.P.I.A., KOTA-324005 (Raj.)
Phone : 0744-2434994
Mob. : +91-8003095306
E-mail: civiltestinglab@gmail.com



ISO Certified

Civil Testing Certified Laboratory

Report No: - C &I/ 23946

Date: -14.12.2022

TEST REPORT

Name of Customer	Delhi Public School Kota
Reference No.	Letter Ref. No. DPSK/12/18/22-23, Date-12.12.2022
Lab. Job No.	23946
Sample Receipt Date	12.12.2022
Name of Work	-----
Material/ Material Identification	Water Sample
Make/Source	-----
Date of Testing	14.12.2022


Discipline: Chemical Testing

Group: Water

TEST RESULTS

S.No.	Parameters	Results	Test Method	Requirement (Acceptable Limit) as per IS10500-2012 RA 2018 Max.
1.	pH Value	7.01	IS-3025-P(11):1983	6.5-8.5
2.	Turbidity (NTU)	Nil	IS-3025-P(10):1982	1.0
3.	Taste	Agreeable	IS-3025-P(8):1984	Agreeable
4.	Colour	APHA	IS-3025-P(4):1987	5
5.	Odour	Agreeable	IS-3025-P(5):1983	Agreeable
6.	T.D.S. (ppm)	99	IS-3025-P(16):1984	500
7.	Total Hardness (mg/lit.)	61.5	IS-3025-P(21):2009	200
8.	Acidity (mg/lit.)	9	IS-3025-P(22):1986	---
9.	Alkalinity (mg/lit.)	63	IS-3025-P(23):1986	200
10.	Chloride (mg/lit.)	32	IS-3025-P(32):1988	250
11.	Sulphate (mg/lit.)	21	IS-3025-P(24):1986	200
12.	Calcium (mg/lit.)	11	IS-3025-P(40):1991	75
13.	Magnesium (mg/lit.)	8	IS-3025-P(46):1994	30

Suwendra
Checked by:

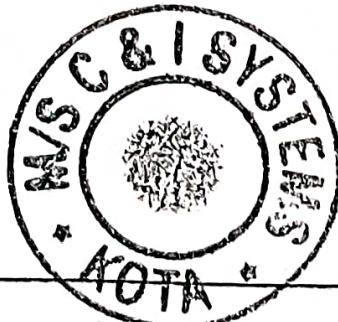

A. Kumar
Authorized Signatory

Note: -

1. The test result refers only to the samples received in the Laboratory.
2. This report shall not be reproduced except in full without written approval from C&I SYSTEMS Laboratory.
3. Any discrepancy in test results should be reported within 15 days from the date of report.
4. C&I SYSTEMS Laboratory shall not in any way be involved in any action following the interpretation of test results.
5. This report is not valid for any Legal proceeding.

End of Report
Page 1 of 1

[Handwritten signature]

